
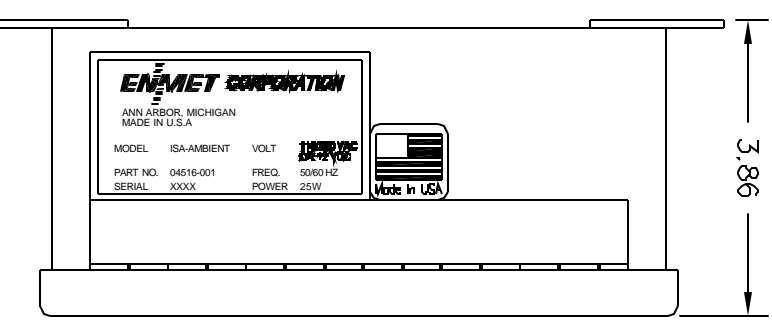


MOUNTING LOCATION OF SENSOR HOUSING IS TO BE DETERMINED BY THE DENSITY OF THE GAS/VAPOR TO BE DETECTED & THE SOURCE OF THE GAS/VAPOR

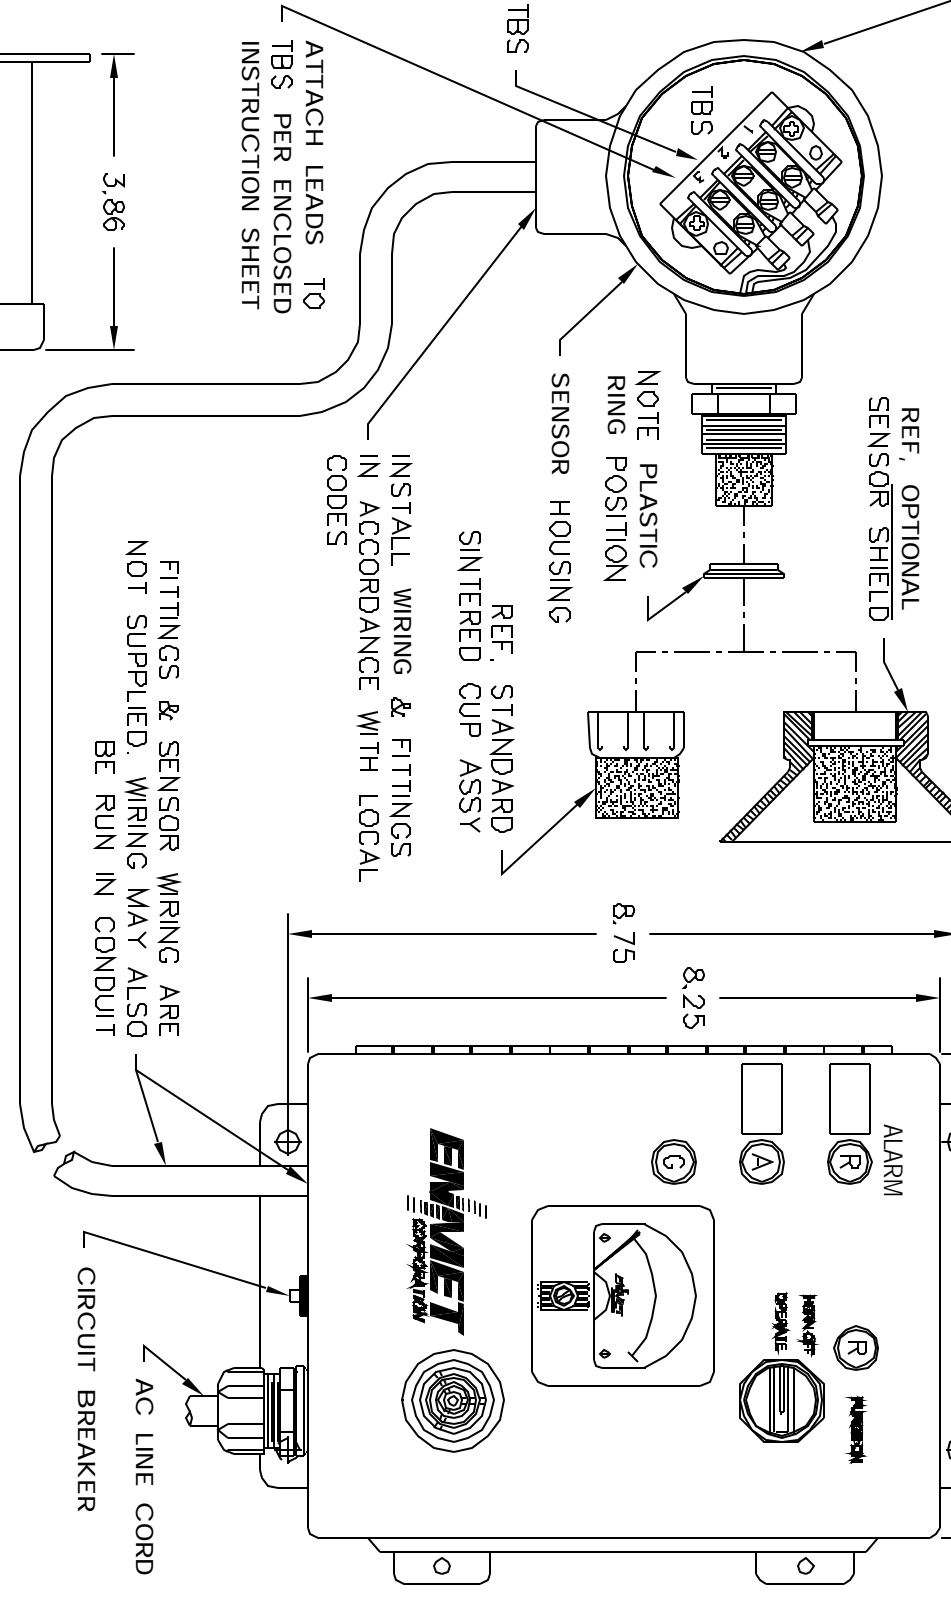

WIRING TABLE

	COLOR	GA	DESCRIPTION
TB2-1		16	RELAY 1 COM.
TB2-2		16	RELAY 1 N.O.
TB2-3		16	RELAY 1 N.C.
TB2-4		16	RELAY 2 COM.
TB2-5		16	RELAY 2 N.O.
TB2-6		16	RELAY 2 N.C.
TB4-1	WHT	16	AC LOW
TB4-2	BLK	16	AC HIGH
TB4-3	GRN	16	AC GND
TB1-5	BLU	20	SENSOR SIGNAL
TB1-6	ORG	20	SENSOR HEATER
TB1-7	BRN	20	SENSOR GND

ANN ARBOR, MICHIGAN
MADE IN U.S.A.

MODEL ISA-AMBIENT VOLT 240VAC
PART NO. 04516-001 FREQ. 50/60 HZ
SERIAL XXXX POWER 25W

ANN ARBOR, MICHIGAN
MADE IN U.S.A.

INSTALLATION DETAIL

ISA-M 04516-001

DATE: 6/21/02

FILE: 04516-001-INSTALL-DET